

Stephen Parry
Chief Executive
Gore District Council
PO Box 8
Gore, 9740

4th November 2020

Dear Stephen

RE: NH₃ Monitoring Report 1st October – 31st October 2020

Background

Gore District Council (GDC) engaged Land and Water Science to conduct continuous monitoring of ammonia (NH₃) gas concentrations from the Mataura Mill dross storage site (121 Kana Street, Mataura) from May 2018. GDC require emission values to comply with consent conditions that specify a limit of 5 ppmV (parts per million by volume) NH₃ discharged to air.

In May 2017, Photonic Innovations (PI) installed two NH₃ sensors for comparison of the indoor and outdoor ammonia levels. Measurements were recorded continuously and reported as a 5-minute average for both the outdoor and indoor sensors. A dashboard to access this data is available in real time at <http://35.213.230.53/d/CPQFoUvGz/gore-district-council?orgId=1&refresh=1m>

October Summary

Weekly summaries of outdoor and indoor emission results from monitoring between 1 October and 31 October are presented in this report. During this period, the maximum NH₃ concentration detected by the outdoor sensor was 4.40 ppmV (Figure 1 and Table 1). Maximum mean and median NH₃ concentrations during this period were 0.51 ppmV and 0.40 ppmV for the outdoor sensor. The maximum ammonia concentration remained below the consented amount of 5.00 ppmV throughout October. Maximum mean and median NH₃ concentrations for the indoor sensor during this period were 2.53 ppmV and 2.40 ppmV.

Daily (diurnal) variation in NH₃ concentration shows a consistent pattern in the data. Specifically, NH₃ concentration is strongly correlated with air temperature, reaching maximum values as air temperatures peak during the day and minimum values at night when air temperatures are at their lowest. Although diurnal variation is evident in the data, average air temperature is a greater control over the absolute concentration with maximum concentrations recorded during the warmest months of the year and minimum concentrations recorded during the coolest months of the year. The correlation between air temperature and NH₃ concentration for this reporting period is displayed in Figure 1.

Table 1. Summary statistics for the Outdoor NH₃ sensor, 1 October – 31 October 2020. NH₃ gas measured in parts per million by volume (ppmV).

Date	1-4 Oct	5-11 Oct	12-18 Oct	19-25 Oct	26-31 Oct
Mean	0.51	0.44	0.43	0.41	0.44
Std Dev	0.36	0.21	0.21	0.22	0.30
Median	0.40	0.40	0.40	0.40	0.40
Minimum	0.20	0.20	0.10	0.20	0.10
Maximum	3.30	3.80	3.10	4.40	4.30

Table 2. Summary statistics for the Indoor NH₃ sensor, 1 October – 31 October 2020. NH₃ gas measured in parts per million by volume (ppmV).

Date	1-4 Oct	5-11 Oct	12-18 Oct	19-25 Oct	26-31 Oct
Mean	2.08	2.25	1.55	2.38	2.53
Std Dev	0.58	0.80	0.61	1.08	0.92
Median	2.10	2.10	1.45	2.20	2.40
Minimum	0.20	0.70	0.10	0.50	0.60
Maximum	3.30	4.60	3.80	5.20	5.30

1 – 4 October 2020

Outdoor NH₃ concentration levels were relatively steady for most of the week with some higher concentrations consistent with warmer temperatures. The maximum outdoor concentration was 3.30 ppmV for this period. Outdoor mean and median values were 0.51 and 0.40 ppmV, respectively.

Indoor NH₃ concentration levels showed consistent variation for most of the week almost mirroring the tendency of the maximum temperature readings. The maximum indoor concentration was 3.30 ppmV for this period. Indoor mean and median values were 2.08 and 2.10 ppmV, respectively.

5 – 11 October 2020

Outdoor NH₃ concentration levels were relatively steady for most of the week with some higher concentrations consistent with warmer temperatures. The maximum outdoor concentration was 3.80 ppmV for this period. Outdoor mean and median values were 0.44 and 0.40 ppmV, respectively.

Indoor NH₃ concentration levels recorded a mean of 2.25 ppmV and a median of 2.10 ppmV. The maximum indoor concentration was 4.60 ppmV for this period.

12 – 18 October 2020

Outdoor NH₃ concentration levels were relatively steady for most of the week with some higher concentrations consistent with warmer temperatures. The maximum outdoor concentration was 3.10 ppmV for this period. Mean and median values were 0.40 ppmV and 0.44 ppmV, respectively.

Indoor NH₃ concentration levels recorded a mean of 1.55 ppmV and a median of 1.45 ppmV. The maximum indoor concentration was 3.80 ppmV for this period.

19 – 25 October 2020

Outdoor NH₃ concentration levels were relatively steady for most of the week. The maximum outdoor concentration was 4.40 ppmV for this period. Mean and median values were both 0.41 and 0.40 ppmV, respectively.

Indoor NH₃ concentration levels recorded a mean of 2.38 ppmV and a median of 2.20 ppmV. The maximum indoor concentration was 5.20 ppmV for this period.

26 – 31 October 2020

Outdoor NH₃ concentration levels were relatively steady for most of the week with some higher concentrations consistent with warmer temperatures. The maximum outdoor concentration was 4.30 ppmV for this period. Mean and median values were 0.44 and 0.40 ppmV, respectively.

Indoor NH₃ concentration levels recorded a mean of 2.53 ppmV and a median of 2.40 ppmV. The maximum indoor concentration was 5.30 ppmV for this period.

Summary

During the monitoring period (1 Oct – 31 Oct) Outdoor NH₃ concentrations reached a maximum of 4.4 ppmV, while maximum mean and median concentrations were 0.51 and 0.4 ppmV, respectively. The outdoor sensor remained below the consent conditions of 5.0 ppmV during the month of October. These values are consistent with cooler outdoor temperatures. Overall, temperature continues to be the most dominant control over NH₃ concentration.

Kind regards



Dianne Elliotte
AquaTech Environmental Data Collection Ltd



Dr Clint Rissmann
Director
Land and Water Science Ltd

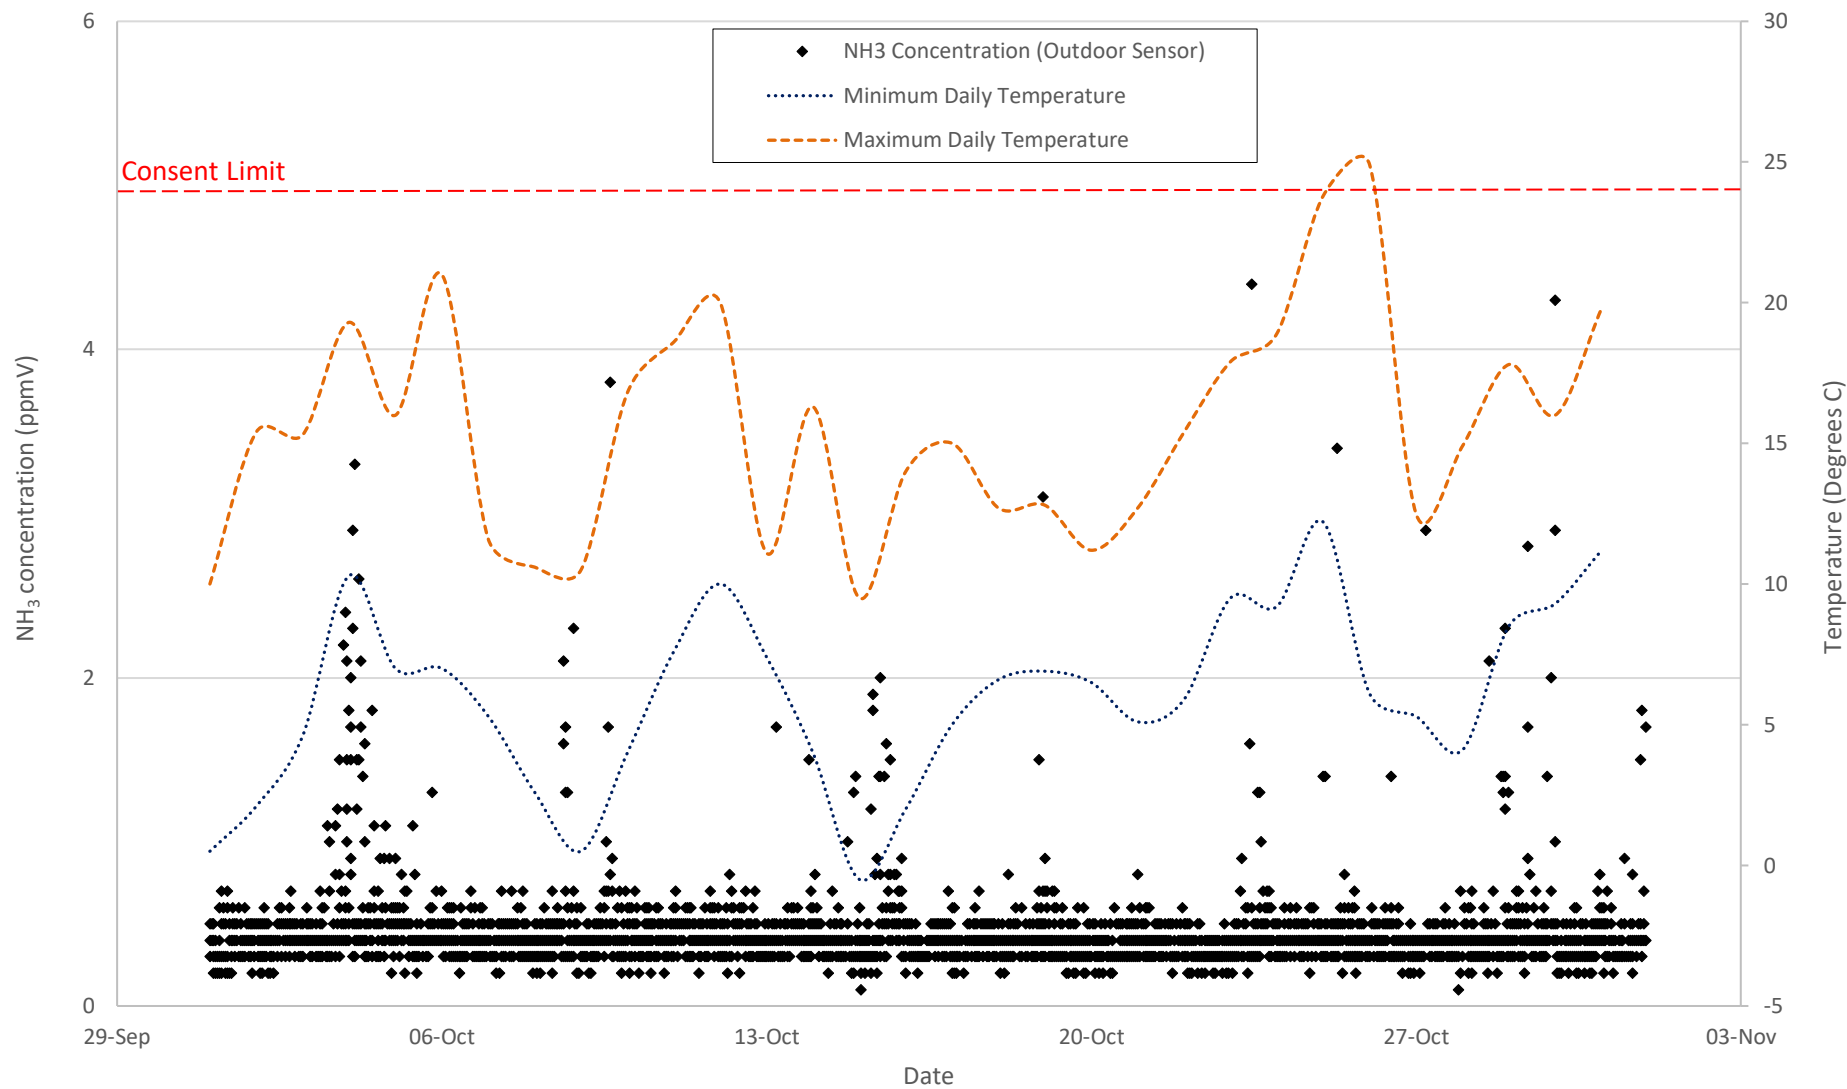


Figure 1: Continuous outdoor NH₃ concentration (ppmV), minimum and maximum daily temperature (°C). Temperature data is sourced from NIWA climate station AWS Gore 5778.

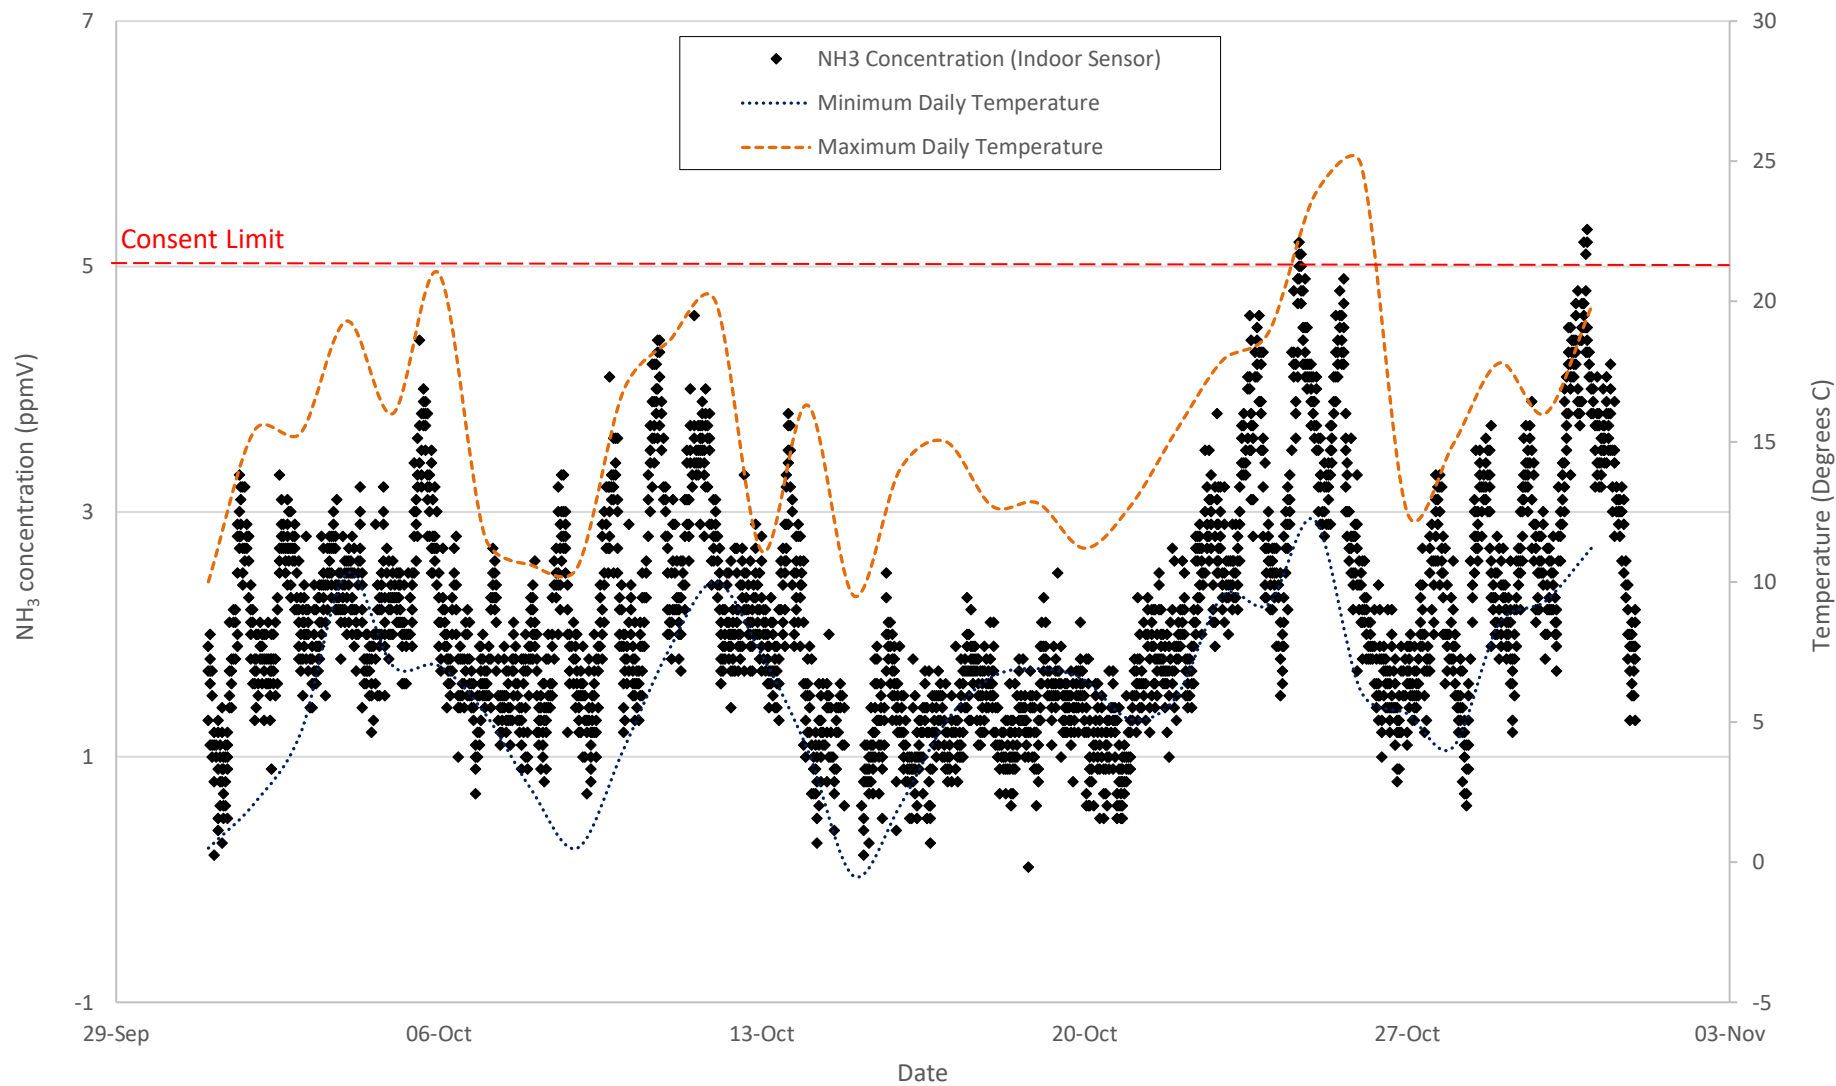


Figure 2: Continuous indoor NH₃ concentration (ppmV), minimum and maximum daily temperature (°C). Temperature data is sourced from NIWA climate station AWS Gore 5778.